Lamp Kit Installation

For installation assistance call (970)667-5146

SUPER VAC
THE VENTILATION SPECIALISTS

1. Disconnect ventilator from power source.

2. Remove (2) handle pivot bolts and nuts. Do not discard, fasteners will be used to secure lamp support bar.

3. Verify that you have the correct lamp kit for your model of ventilator. Lamp support bars are specific to individual ventilators.

4. Orient lamp bar such that the small leg of the angle bracket rests on top of ventilator handle when handle is in folded position. Re-install pivot bolts and nuts.

5. Torque nuts to provide for the desired level of effort to swing handle.

6. Drill 1/2 inch diameter hole on top face of electrical connection box on motor. Install toggle switch (provided with kit) through this hole.

7. Drill 3/4 inch diameter hole in rear face of electrical connection box on motor. Route twist-lock disconnect with pig-tail leads through this hole.

8. Remove all traces of metal chips from electrical box.

9. Connect white wire from pig-tail end to white wire in electrical box using insulated crimp connector provided.

10. Crimp female quick disconnect (FQD) crimp terminal to black pigtail wire. Connect FQD to one switch terminal.

11. Crimp FQD terminal to black wire from motor. Connect FQD to remaining terminal on switch.
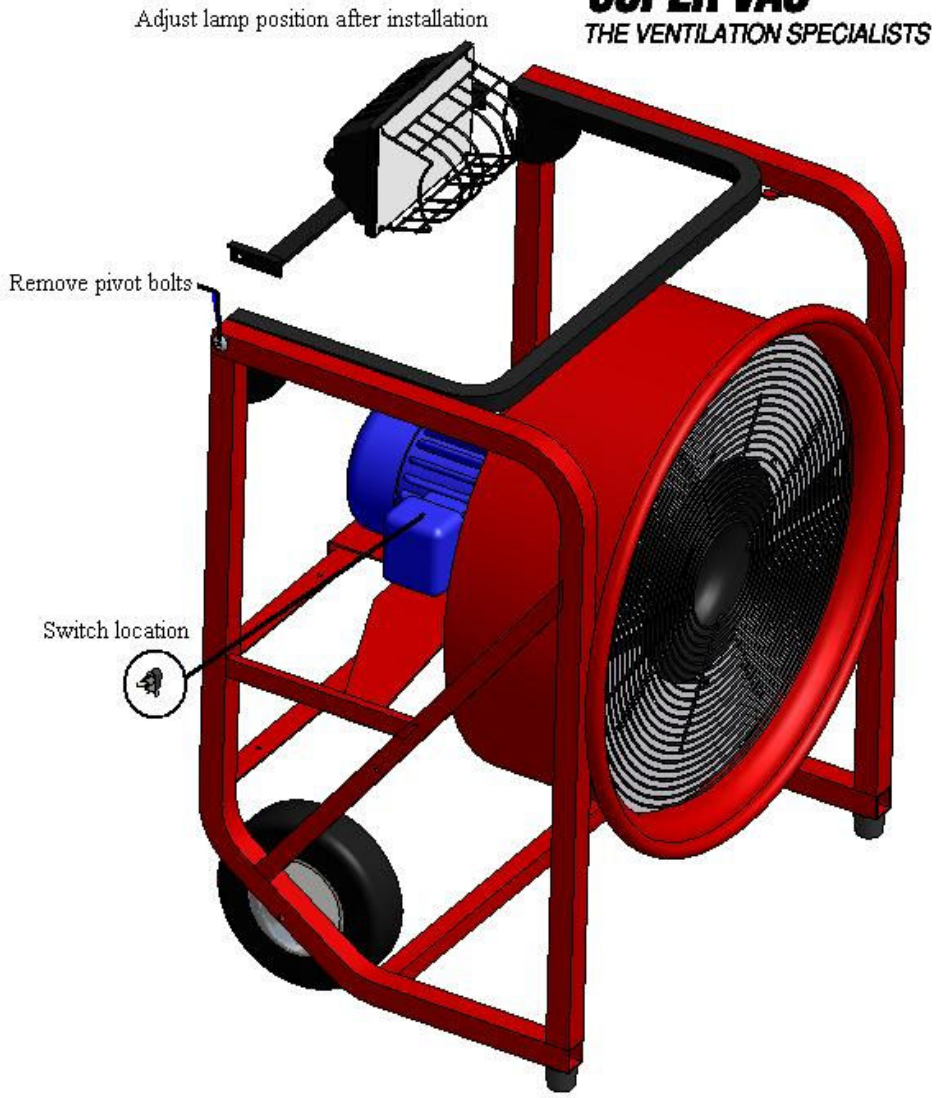
12. Replace any covers or guards removed. Verify that no wires are pinched or conductors exposed before operating ventilator.